


## MWS1-IP WEATHERPROOF MICROWAVE PRESENCE DETECTOR (WALL)

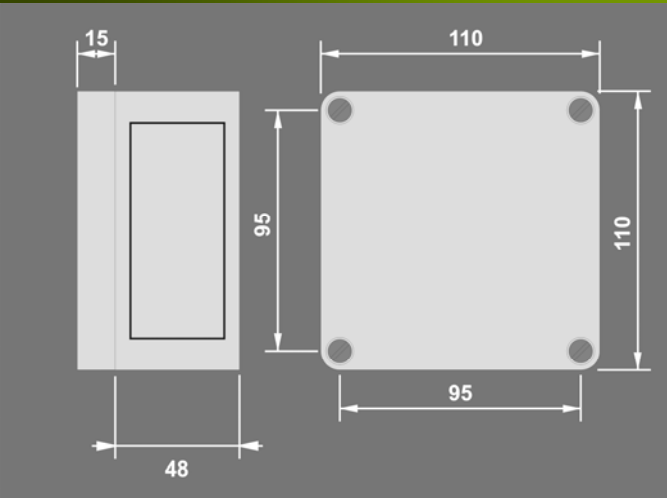

### WIRING

Wire the MWS1-IP products as in the diagram.

To switch from more than one position simply wire two or more units in parallel to achieve two way and intermediate switching.

The detector should be sited so that the occupants of the room fall inside the detection pattern shown overleaf, at a recommended height of 1.2m to 1.5m for wall sensors. Note that the higher the sensor is installed the shorter the detection range will be.

- Do not site within 1m of any lighting or ventilation equipment.
- Do not fix to a vibrating surface.
- Site as far away as possible from the surface of metal objects.
- Ensure that all cable entry to the enclosure is via suitable cable glands and seal with silicone sealant where appropriate.
- If it is necessary to screw through the rear of the enclosure ensure that any holes are covered with the caps provided and sealed with silicone sealant where appropriate.

### INSTALLATION

**Warning.** This device works at mains potential. Be sure to take care when working with electricity.


1. Make sure the load is connected and in working order.
2. Isolate the mains supply to the circuit at the main consumer unit.
3. Connect the controller via the terminal block. Live supply to the *L* terminal, Neutral to the *N* terminal and the load to the *LIVE OUT* terminal.
4. MWS1/LUX only—set the LUX level thumbwheel fully clockwise.
5. Set the time to minimum (fully anticlockwise) and the sensitivity to maximum (fully clockwise).
6. Screw the unit to the wall and switch the mains supply back on at the distribution board.
7. The load should come on immediately.
8. Vacate the room or remain very still and wait for the load to switch off (should take no more than 2 minutes). Check that the load switches on when movement is detected.
9. MWS1/LUX only—to set the LUX level wait until the level of natural daylight is just enough that lighting is required. Starting with the LUX thumbwheel fully anti-clockwise. Very slowly turn the thumbwheel clockwise until the lights come on. Note that when the LUX thumbwheel is fully clockwise then the lights will **always** come on with occupancy.
10. Select the time out range using the thumbwheel, fully clockwise is the maximum.
11. **Note: on maximum sensitivity this unit is extremely sensitive to movement and may detect through thin walls or partitions. If this causes a problem reduce the sensitivity by turning the thumbwheel anticlockwise.**

### DESCRIPTION AND OPERATION

The MWS1 series of microwave presence detector switches are designed to provide automatic control of lighting, heating or ventilation loads. The MWS1 detects movement using a highly sensitive microwave detector. This works by emitting low power microwave signals and measuring the reflections as the signals bounce off moving objects. The MWS1 is optimised for wall mounting applications to give detection over long distances.

When movement is detected the load is turned on. When an area is no longer occupied the load will switch off after an adjustable time out period.


An optional internal light sensor provides additional energy saving in lighting applications (MWS1-IP/LUX). When an area is occupied lighting is only switched on when the level of natural light is below a preset level.

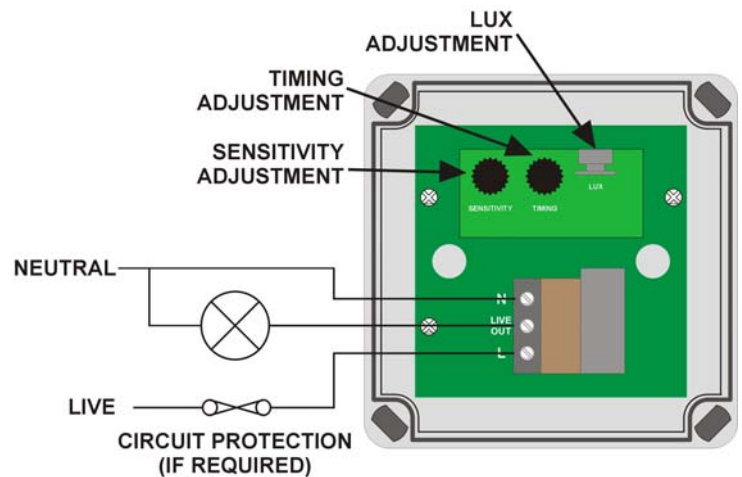

## DETECTION PATTERN

### PLAN VIEW

30 m

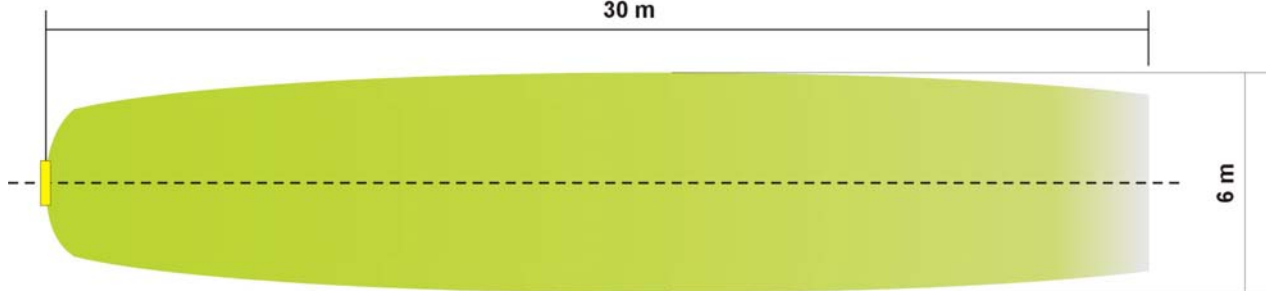

AREA OF HIGH SENSITIVITY

AREA OF LOW SENSITIVITY

## FAULT FINDING

### LOAD DOES NOT COME ON

Check to see if the live supply to the circuit is good. Strap across the *L* and *LIVE OUT* terminal to turn the load on.

For LUX versions only, if the supply and wiring are good, check the LUX level setting. Increase the LUX level setting to allow the controller to turn on at higher ambient natural light level.

### LIGHTS DO NOT GO OFF

Ensure that the area is left unoccupied for a greater time period than the time out period set using the switch.

Make sure that the sensor is not adjacent to vibrating surfaces or objects (e.g. ventilation equipment).

The unit may pick up movement through thin partitions or walls. Reduce the sensitivity by turning the thumbwheel anticlockwise.


## SPECIFICATION

### LOAD

10A of lighting and or ventilation including incandescent, fluorescent, compact fluorescent, low voltage (switch primary of transformer).

<b>SUPPLY VOLTAGE</b>	220-240 Volts AC 50 Hz
<b>TIME OUT PERIOD</b>	Adjustable 15 seconds to 30 minutes.
<b>LIGHT LEVEL</b>	Optional adjustment by thumbwheel light to dark.
<b>TERMINAL CAPACITY</b>	4.0mm <sup>2</sup>
<b>IP RATING</b>	IP 66
<b>MATERIAL</b>	Polystyrene
<b>TYPE</b>	Class 2
<b>TEMPERATURE</b>	-10°C to 35°C
<b>SAFETY</b>	The microwave radiation emitted by these units is extremely low power.

### CONFORMITY

EMC-89/336/EEC   
LVD-73/23/EEC

## PART NUMBERS

MWS1-IP	Weatherproof wall mounted microwave presence detector
MWS1-IP/LUX	Weatherproof wall mounted microwave presence detector with integral light sensor

### IMPORTANT NOTICE!

This device should be installed by a qualified electrician in accordance with the latest edition of the IEE wiring regulations.

Due to our policy of continual product improvement CP Electronics reserves the right to alter the specification of this product without prior notice.

**C.P. Electronics Ltd**  
Unit 2 Abbey Manufacturing Estate  
Mount Pleasant, Wembley  
Middlesex. HA0 1RR

Tel: + 44 (0) 20 8900 0671  
Fax: + 44 (0) 20 8900 0674  
www.cpelectronics.co.uk  
enquiry@cpelectronics.co.uk



FMA5709

